

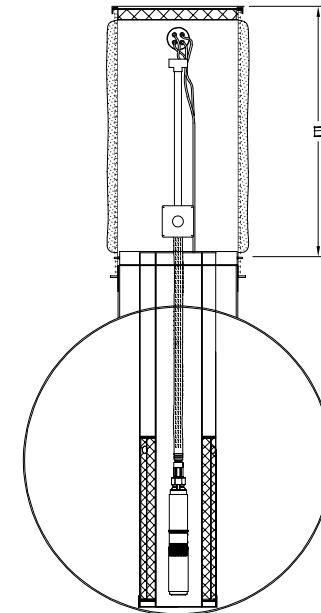


	1250	1500	
RESERVE CAPACITY ABOVE ALARM	161 GAL	192 GAL	
CAPACITY BETWEEN PUMP ON & PUMP OFF	109 GAL	131 GAL	
FLOAT LEVEL	CENTER FLOAT CORD AT		
SETTINGS ABOVE VAULT	ALARM	45"	46"
BOTTOM	ON / OFF	41"	42"
SHELL	12 Ga	12 Ga	
DIAMETER	58-1/2	58-1/2	
LENGTH	121	145	
COMPARTMENT A	81	97	
COMPARTMENT B	40	48	
INLET INVERT	51	51	
NORMAL APPLICATION	RESIDENTIAL	RESIDENTIAL	

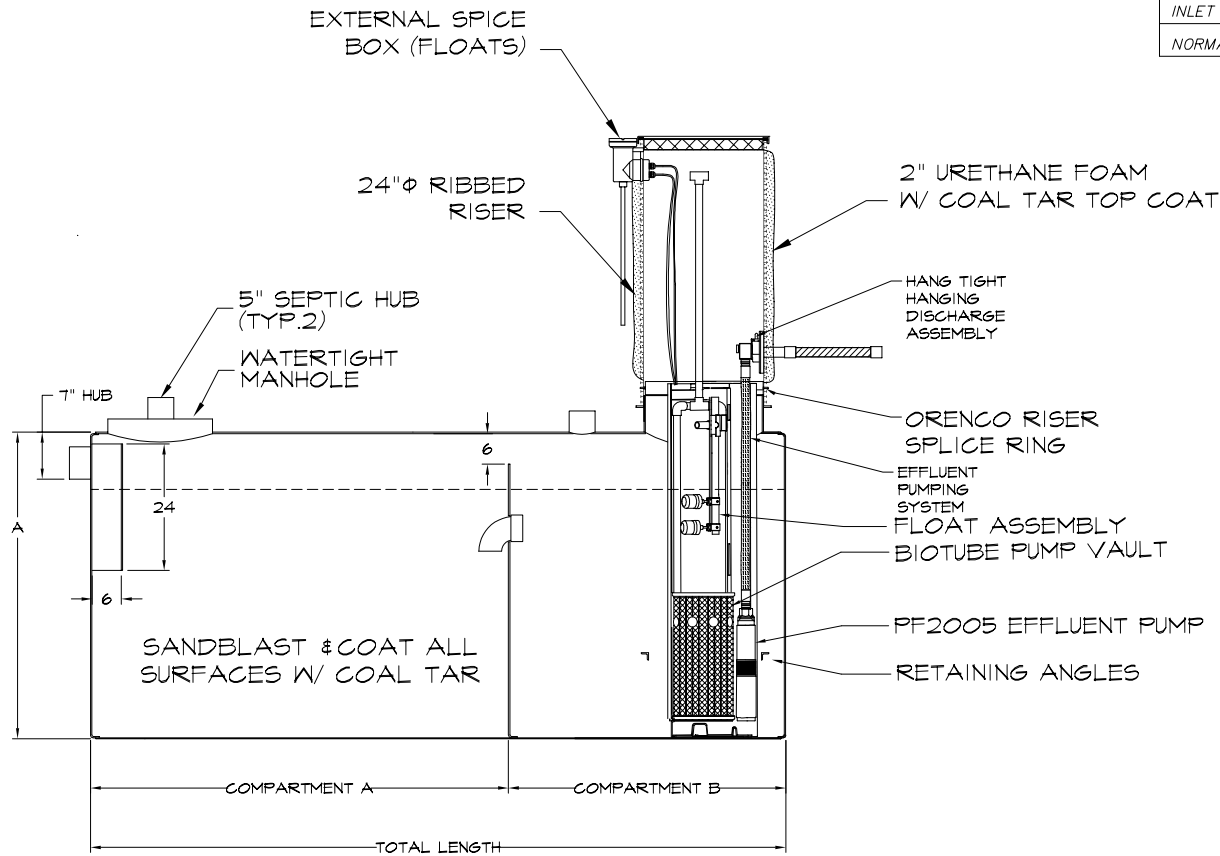

END VIEW
(SIMPLEX PUMPING SYSTEM SHOWN)

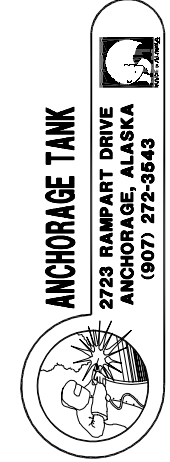

**STANDARD LIFT STATIONS
RESIDENTIAL
STANDARD ASSEMBLY**

DRAWN: SIMON
DATE: 4/15/24
REVISED: 9/17/24
FILE NAME: LIFTSTANDARD
JOB NO: STND
SCALE: NTS
SHEET No. 1 OF 1